


- CONSTRUCTION OF IMPROVEMENTS SHALL BE IN ACCORDANCE WITH THE EAST WENATCHEE WATER DISTRICT DEVELOPER EXTENSION AGREEMENT (as applicable), DISTRICT STANDARD DETAILS AND THE STANDARD SPECIFICATIONS FOR ROAD, BRIDGE AND MUNICIPAL CONSTRUCTION, MOST CURRENT EDITION, AS ISSUED BY THE WA. STATE DEPT. OF TRANSPORTATION.
- A RECONSTRUCTION CONFERENCE IS REQUIRED PRIOR TO CONSTRUCTION AND 48 HOURS ADVANCE NOTIFICATION OF THE LOCAL MUNICIPALITY, THE EAST WENATCHEE WATER DISTRICT AND ALL AFFECTED UTILITY COMPANIES PRIOR TO THE ACTUAL START OF WORK.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR COMPLYING WITH THE PROVISIONS OF THE RIGHT-OF-WAY/STREET CONSTRUCTION PERMIT AS ISSUED BY THE DOUGLAS COUNTY DEPT. OF TRANSPORTATION AND LAND SERVICES, CITY OF EAST WENATCHEE, AND/OR WA. STATE DOT FRANCHISE FOR THIS PROJECT.
- LOCATIONS OF EXISTING UTILITIES SHOWN ON THE PLANS ARE ESTIMATED UNLESS STATED OTHERWISE. IT IS THE CONTRACTOR'S RESPONSIBILITY TO VERIFY, LOCATE AND PROTECT ALL UTILITIES WITHIN THE PROJECT AREA. THE CONTRACTOR SHALL BE RESPONSIBLE FOR REPLACING OR REPAIRING ANY UTILITIES DAMAGED DURING CONSTRUCTION. SHOW ENCOUNTERED UTILITIES ON THE AS-BUILTS.
- LOCATION AND EXTENT OF IRRIGATION PIPELINES WITHIN THE PROJECT LIMITS ARE UNKNOWN. CONTRACTOR SHALL CONTACT PROPERTY OWNERS ADJACENT TO THE PROJECT FOR LOCATING PRIVATE IRRIGATION SYSTEMS. CONTRACTOR IS RESPONSIBLE FOR LOCATING IRRIGATION MAINS AND REPLACING OR REPAIRING PIPELINES DAMAGED DURING CONSTRUCTION. SHOW THESE PIPELINES ON THE AS-BUILTS.
- WATER MAIN TRENCH SECTION AND ALL EXCAVATED AREAS SHALL BE BACKFILLED AND COMPACTED IN ACCORDANCE WITH THE STANDARD DETAILS AND WITH SECTIONS 7-9.3(10) AND 7-9.3(11) OF THE STANDARD SPECIFICATIONS. COMPACTION TESTING IS REQUIRED DURING BACKFILLING OPERATIONS AT THE DISCRETION OF THE WATER DISTRICT. IF TRENCH BACKFILL DOES NOT MEET COMPACTION REQUIREMENTS, CONTRACTOR SHALL EXCAVATE, RECOMPACT AND RETEST MATERIAL AT CONTRACTOR'S EXPENSE.
- RESTORATION OF DAMAGED ROAD SURFACING SHALL BE IN ACCORDANCE WITH THE LOCAL MUNICIPALITY'S REQUIREMENTS. ALL OTHER AREAS SHALL BE RESTORED TO ORIGINAL CONDITION OR AS DIRECTED BY THE DISTRICT. THIS INCLUDES SHOULDERS, LANDSCAPING, WALLS, FENCES AND OTHER IMPROVEMENTS.
- THE WATER MAIN SHALL BE INSTALLED WITH A MINIMUM OF 48" OF COVER. INSTALLATION OF MAIN WITH GREATER THAN 54" OF COVER IS ACCEPTABLE ONLY WITH THE APPROVAL OF THE WATER DISTRICT. ALL SERVICES, FIRE HYDRANTS AND THRUST BLOCKING SHALL BE INSPECTED BY THE DISTRICT BEFORE BURY.
- DISTRICT APPROVED THRUST RESTRAINTS ARE REQUIRED FOR ALL UNRESTRAINED FITTINGS. RESTRAINED JOINTS ARE ALLOWED FOR VERTICAL BENDS, WHERE BLOCKING IS NOT PRACTICAL OR INEFFECTIVE, AND ARE REQUIRED FOR MAINS THAT WILL BE EXTENDED.
- A SANITARY GAP MUST BE PROVIDED BETWEEN THE EXISTING AND NEW WATER SYSTEMS. CONNECTION TO THE EXISTING WATER SYSTEM SHALL BE PERFORMED BY THE CONTRACTOR ONLY AFTER COMPLETING AN ACCEPTABLE HYDROSTATIC PRESSURE TEST AND THE PIPELINE IS DISINFECTED, FLUSHED AND RECEIPT OF WATER QUALITY TEST RESULTS FROM THE HEALTH DISTRICT OR LAB.
- CONTRACTOR SHALL PERFORM PRESSURE TEST AT 250psi, INCLUDING HYDRANTS AND SERVICE LINES, SETTERS, AND TAILPIPE. MAINLINE SHALL BE TESTED IN SECTIONS OF NO MORE THAN 1,500 FEET. PRESSURE DROP SHALL NOT EXCEED 5psi IN 60 MINUTES. THE DISTRICT INSPECTOR HAS DISCRETION TO MODIFY THE TESTING REQUIREMENTS AS HE DEEMS APPROPRIATE.
- A PIPE PLUG SHALL BE USED ON EACH JOINT DURING INSTALLATION TO PROTECT AGAINST SOIL INTRUSION AND FLOODING OF THE PIPE. OPEN ENDS OF VALVES SHALL BE PLUGGED OR BAGGED UNTIL EXTENDED WITH PIPE.
- NO OTHER PARALLEL UTILITIES SHALL BE INSTALLED WITHIN 36" HORIZONTALLY OF ANY ACTIVE WATER LINE UNLESS OTHERWISE PRE-APPROVED BY THE DISTRICT.
- CONTRACTOR SHALL POthOLE A SUFFICIENT DISTANCE AHEAD OF PIPELAYING TO VERIFY DEPTH OF EXISTING WATER MAINS AND CROSSING UTILITIES AND TO ANTICIPATE ANY NECESSARY CHANGES IN FITTINGS OR ALIGNMENT.
- ALL METAL PRODUCTS (VALVE BOXES EXCLUDED) AND FITTING COMPONENTS (e.g. BOLTS, GASKETS, ETC) ARE TO BE OF DOMESTIC FABRICATION & CONSTRUCTION. ONLY FORD, McDONALD AND MUELLER PRODUCTS ARE APPROVED FOR USE AS SERVICE BRASS, EXCEPT WHERE OTHERWISE NOTED IN THESE STANDARD DETAILS. ALL PE PIPE SHALL BE MIN 200psi RATED CTS (Copper Tube Size). GASKETS FOR ALL FLANGED FITTINGS SHALL BE RING TYPE ONLY, FULL FACED GASKETS ARE NOT ACCEPTABLE.
- AN AS-BUILT RECORD MUST BE SUBMITTED TO THE DISTRICT BEFORE WATER SERVICE WILL BE PROVIDED.
- DEFLECTION AT PIPE AND FITTING JOINTS WILL BE ALLOWED UP TO 3.0" (11" OVER 18") OR AS RECOMMENDED BY MANUFACTURER, WHICHEVER IS LESS.

<b>East Wenatchee Water District</b>	WATER SYSTEM STANDARD DETAIL		
	<b>CONSTRUCTION NOTES PAGE 1 of 2</b>		
File:EMDTW12	Revised: JAN 25, 2017	Printed: JAN 25, 2017	


- CONTRACTOR SHALL ONLY DISPOSE OF WASTE MATERIAL AT SITES APPROVED BY DOUGLAS COUNTY TRANSPORTATION AND LAND SERVICES. STOCKPILE MATERIALS ONLY ON DISTRICT APPROVED SITES.
- ALL PIPE 3" AND LARGER SHALL BE DUCTILE IRON. PIPE SHALL BE MINIMUM CLASS 50 EXCEPT WHERE TRENCH BACKFILL AND LOADING DICTATE A STRONGER CLASS PIPE. CLASS 52 SHALL BE USED FOR HYDRANT RUNS AND IN AREAS WHERE PRESSURE EXCEEDS 150 PSI.
- CONTRACTORS WORKING WITHIN THE RIGHT OF WAY OR ON EXISTING DISTRICT INFRASTRUCTURE SHALL BE LICENSED, BONDED AND HAVE EXPERIENCE INSTALLING PUBLIC DOMESTIC WATER SYSTEMS AND BE PREPARED TO PRESENT EXAMPLES OF 5 SUCH PROJECTS UPON REQUEST BY THE DISTRICT.
- VAULT LID NOTE:** FOR ALL TAPER-TOP STYLE VAULTS FOR WATER SERVICES, AIR VALVES, PERMANENT BLOW-OFFS AND OTHER PURPOSES, CONTRACTOR TO PURCHASE LID AND FRAME EQUAL TO EAST JORDAN IRONWORKS' EAST WENATCHEE WATER DISTRICT SPECIFICATION, FRAME 3619Z, LID 3619C (TRAFFIC) 3620C (NONTRAFFIC). ANCHOR FRAME TO VAULT USING NON-SHRINK GROUT. FRAME AND LID TO BE RATED FOR TRAFFIC LOADING IN TRAFFIC AREAS. WATER SERVICE VAULT LIDS TO INCLUDE ONE INTEGRAL 1.75" DIAMETER RECESS FOR RADIO. FOR AIR VALVES AND BLOW-OFFS, DO NOT DRILL HOLE IN LIDS, NOR PROVIDE "METER" TEXT ON FRAME.
- REPAIR OF EXISTING IRRIGATION SYSTEMS DAMAGED DURING CONSTRUCTION MUST USE PRODUCTS OF NO LESSER QUALITY THAN SCH 40 PVC.
- CONTRACTOR TO PROVIDE NO LESS THAN 48 HOURS NOR MORE THAN 72 HOURS NOTICE TO THE DISTRICT PRIOR TO ANY REQUESTED SHUTDOWN OR CUSTOMER SERVICE OUTAGE. DISTRICT WILL PROVIDE NOTICE TO CUSTOMERS 24 HOURS IN ADVANCE OF OUTAGE.
- NO RESTRAINTS, GASKETS, OR RESTRAINED PIPES (PORTIONS AFFECTED BY RESTRAINTS) MAY BE REUSED ONCE ASSEMBLED.
- FLANGE GASKETS MUST BE RING TYPE (NOT FULL FACE) AND MINIMUM 3/8" THICK. FLANGE BOLTS MUST BE ASTM A307 GRADE A OR B. STEEL BOLTS, NUTS AND WASHERS TO BE ZINC PLATED.




<b>East Wenatchee Water District</b>	WATER SYSTEM STANDARD DETAIL		
	<b>CONSTRUCTION NOTES PAGE 2 of 2</b>		
File:EMDTW9	Revised: JAN 25, 2017	Printed: JAN 25, 2017	

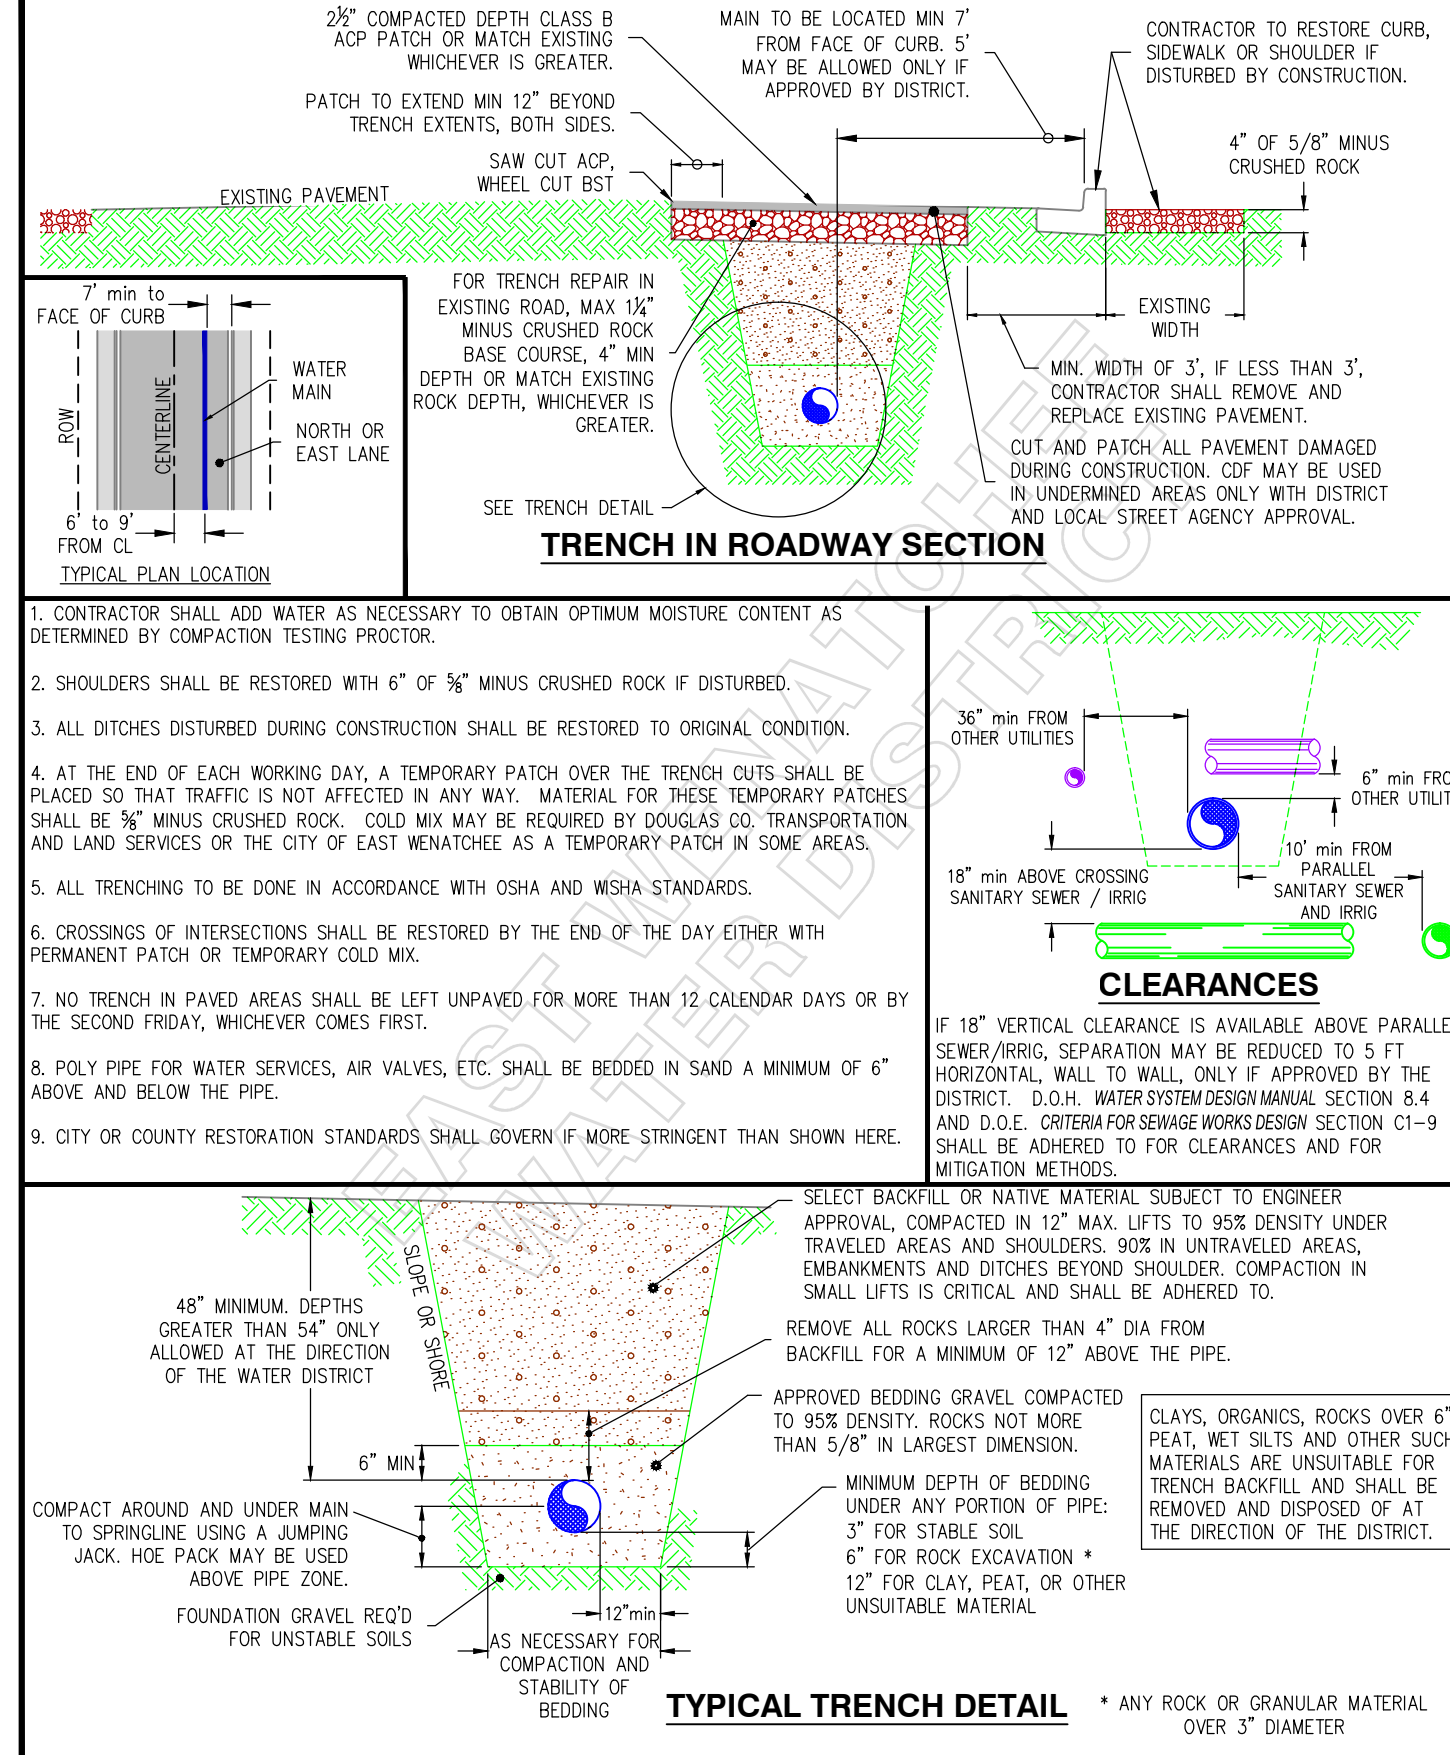


<b>East Wenatchee Water District</b>	WATER SYSTEM STANDARD DETAIL		
	<b>TRENCH SECTION AND RESTORATION</b>		
File:EMDTW22	Revised: NOV 10, 2010	Printed: NOV 10, 2010	

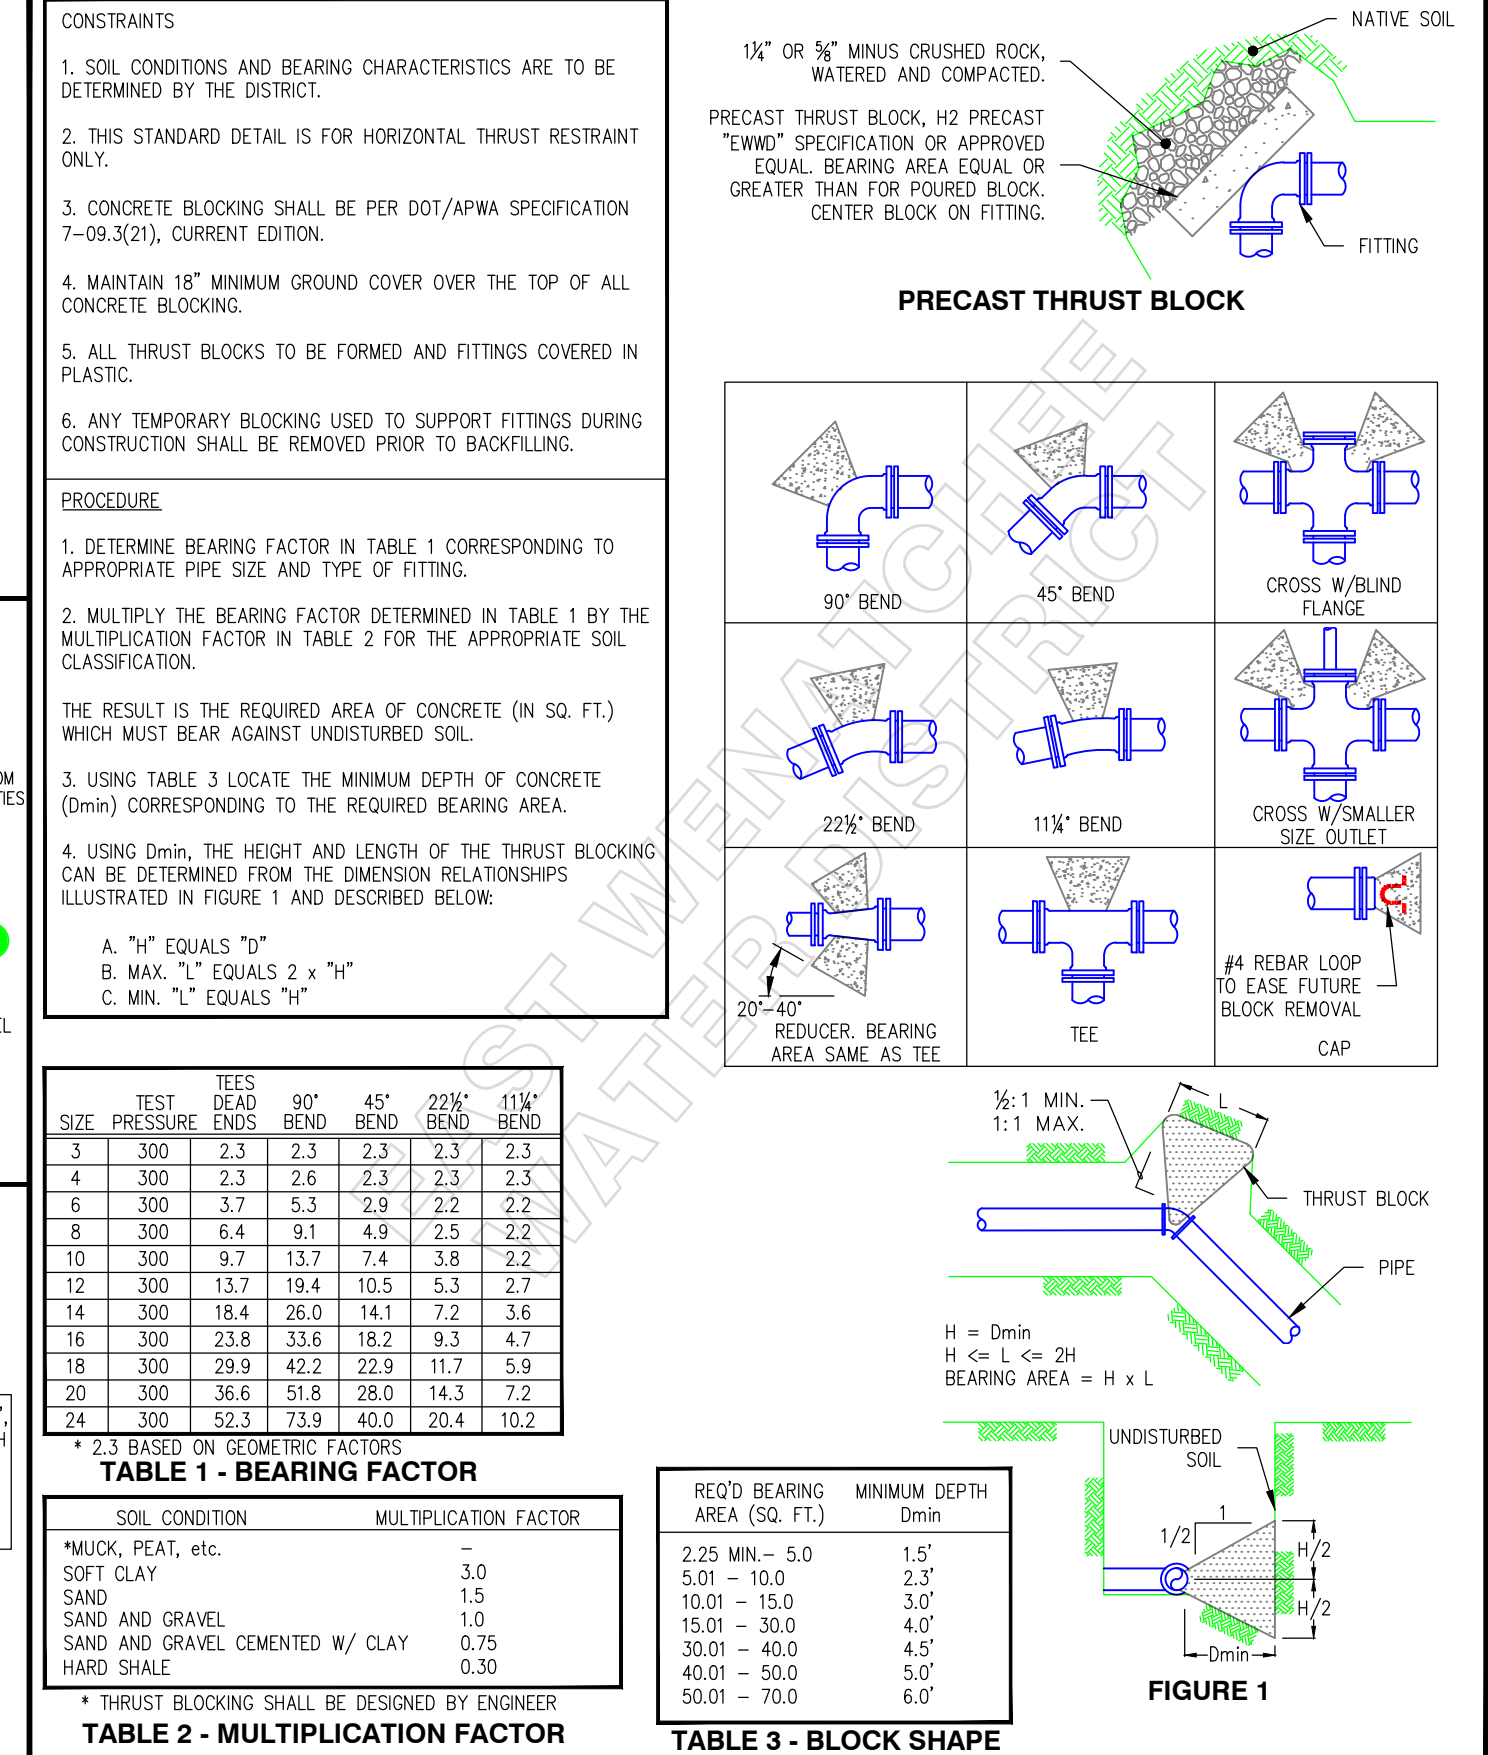


<b>East Wenatchee Water District</b>	WATER SYSTEM STANDARD DETAIL		
	<b>HORIZONTAL THRUST BLOCKING</b>		
File:EMDTW6	Revised: JUN 3, 2010	Printed: JUN 3, 2010	

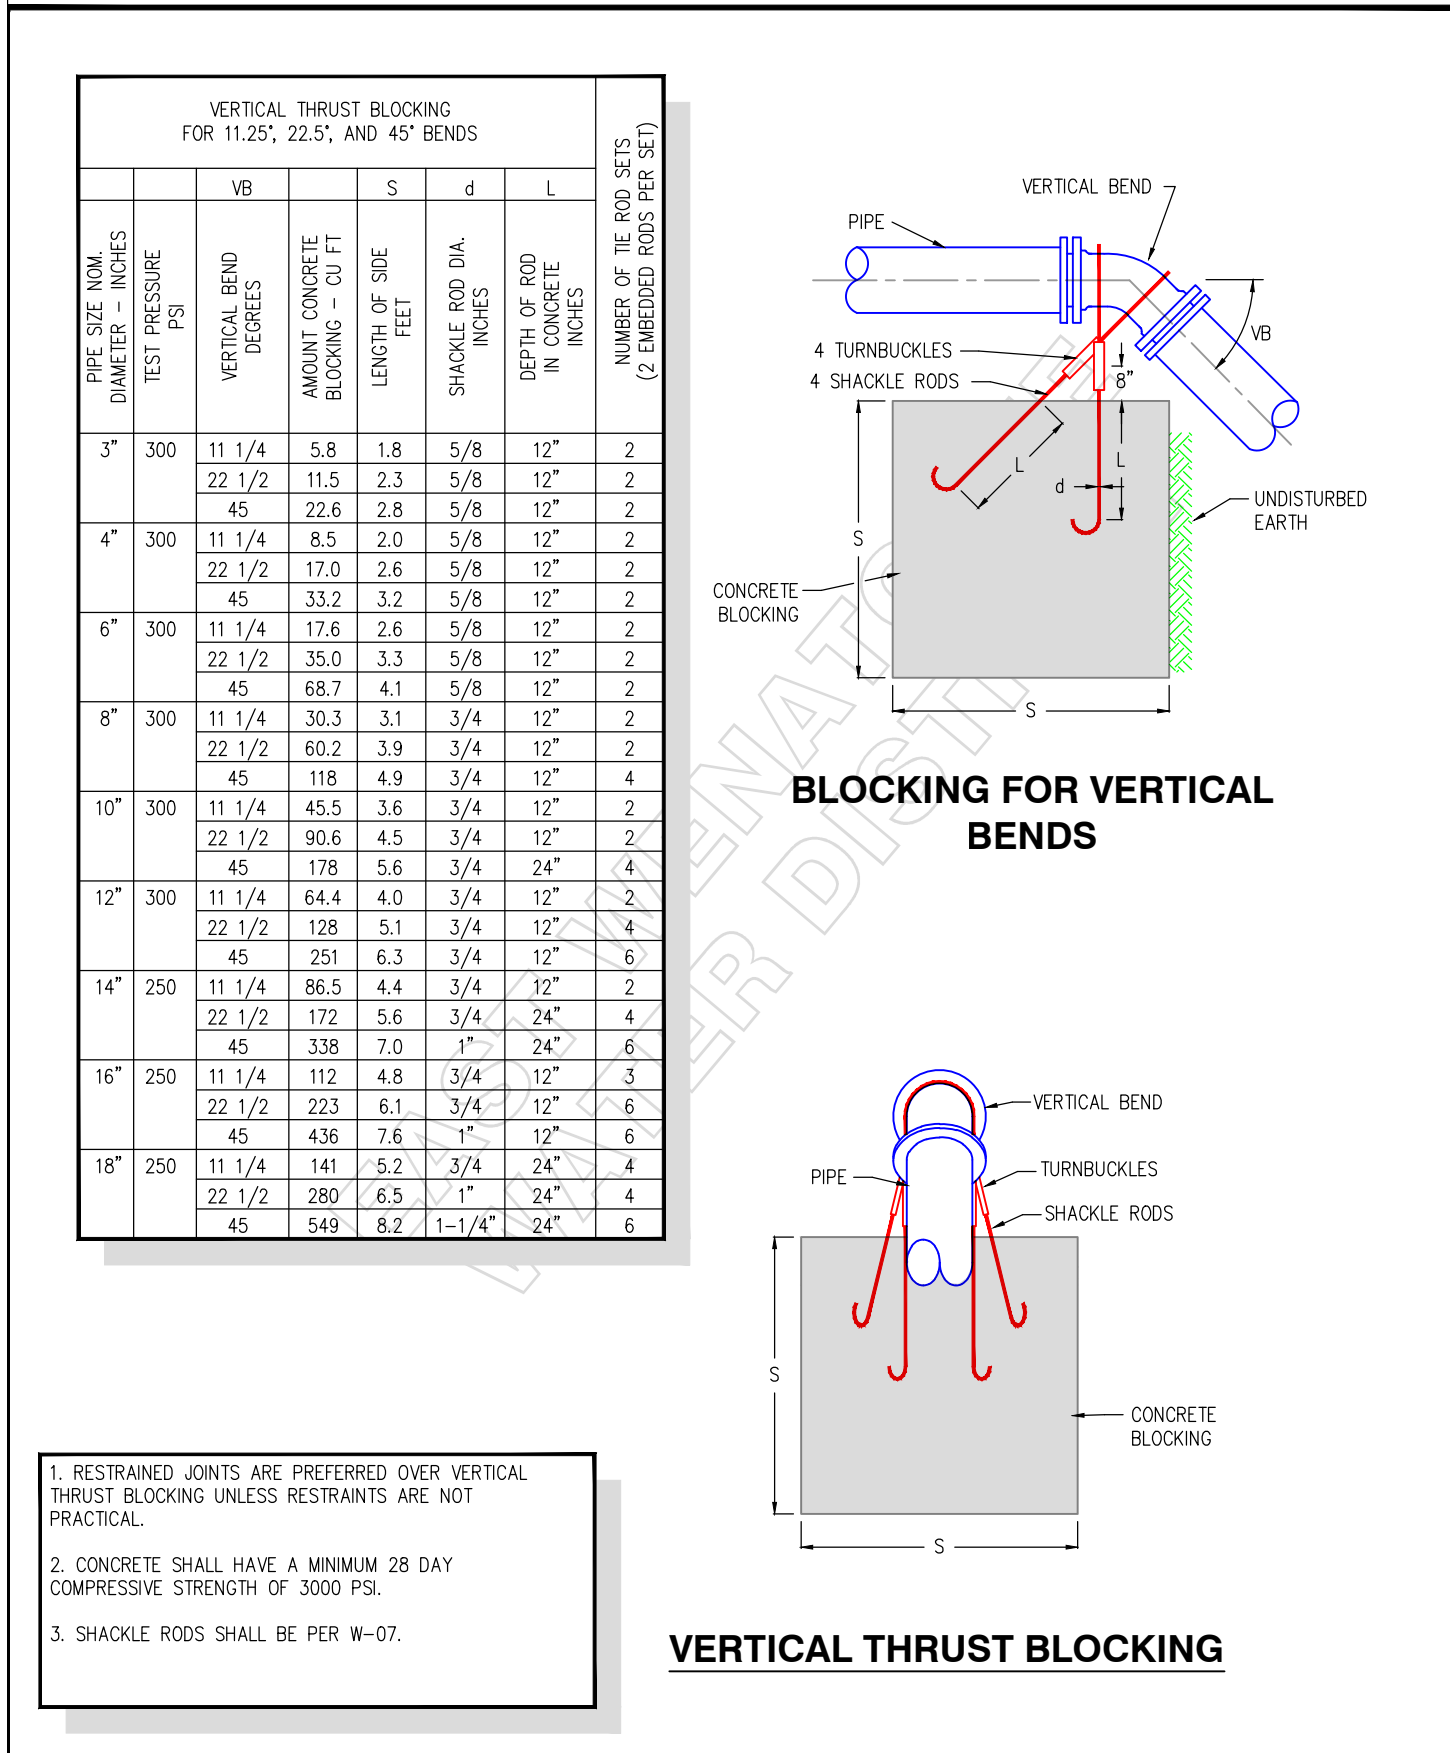


<b>East Wenatchee Water District</b>	WATER SYSTEM STANDARD DETAIL		
	<b>VERTICAL THRUST BLOCKING</b>		
File:EMDTW13	Revised: APR 13, 2007	Printed: JUL 16, 2008	

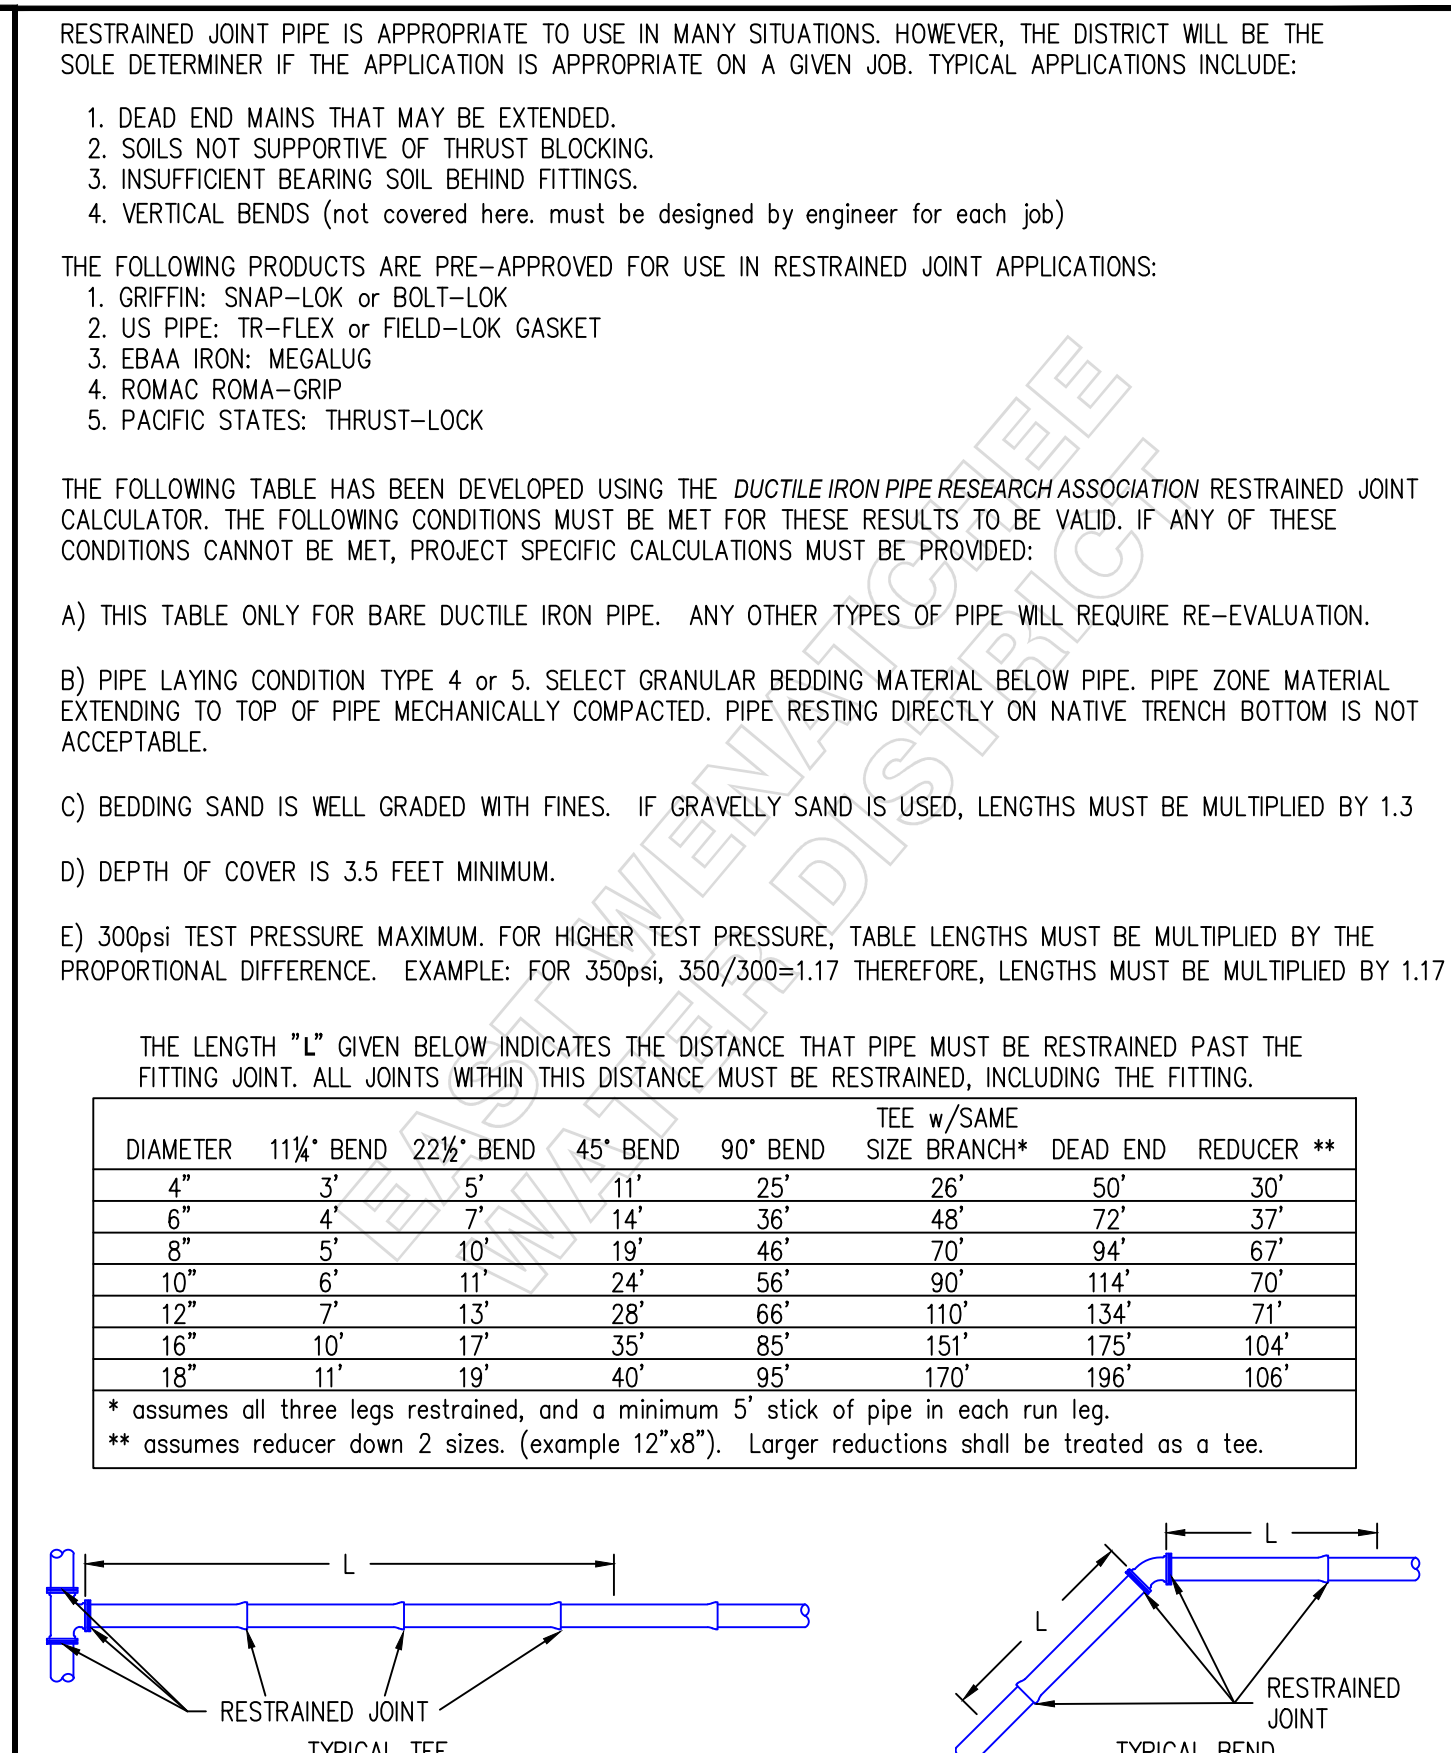

<b>East Wenatchee Water District</b>	WATER SYSTEM STANDARD DETAIL		
	<b>RESTRAINED JOINT PIPE</b>		
File:EMDTW16	Revised: OCT 6, 2010	Printed: OCT 6, 2010	

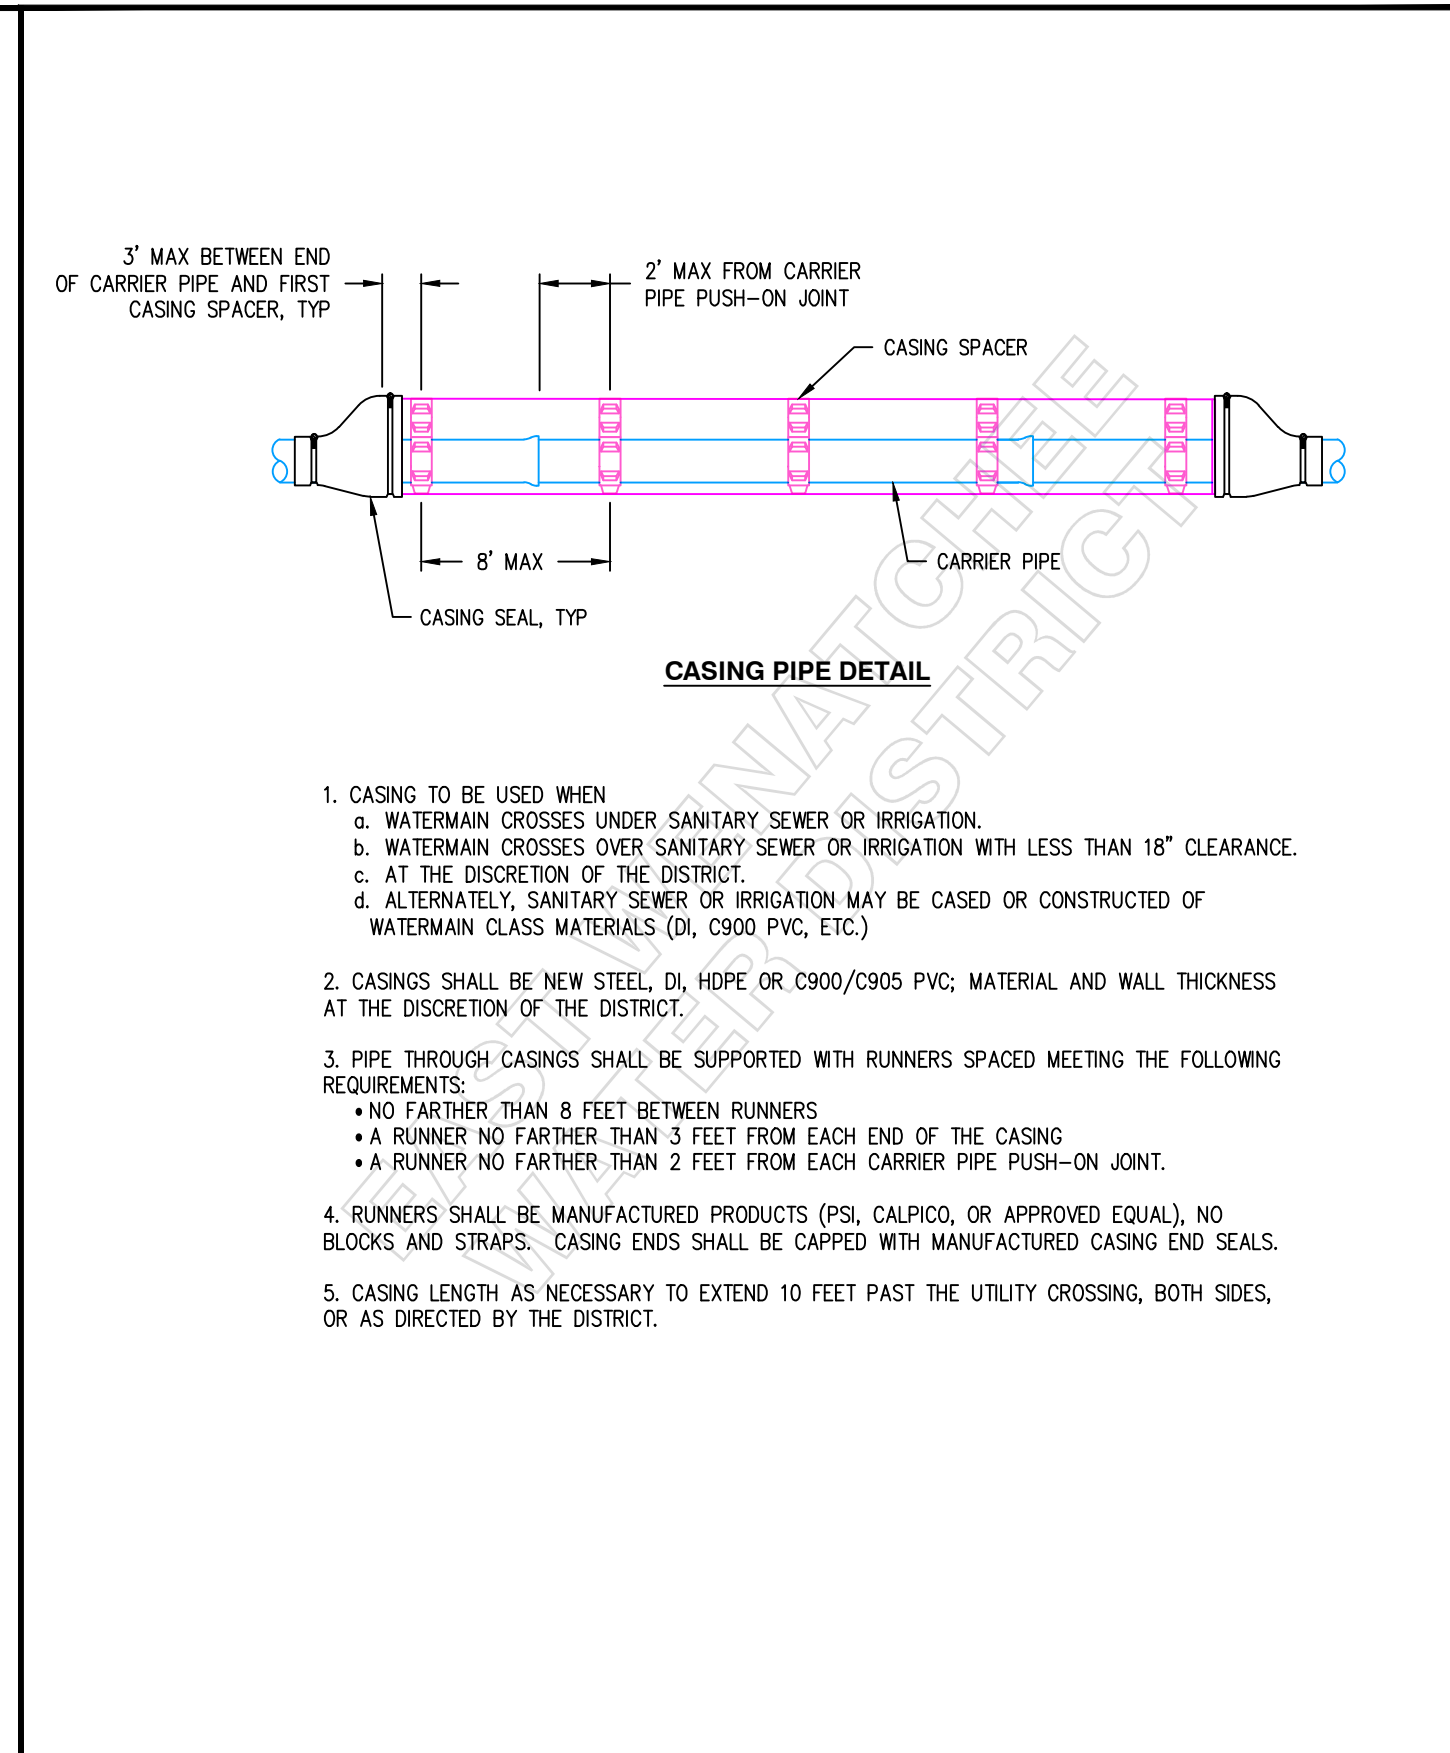

<b>East Wenatchee Water District</b>	WATER SYSTEM STANDARD DETAIL		
	<b>PIPE CASING</b>		
File:EMDTW32	Revised: JAN 25, 2017	Printed: JAN 25, 2017	

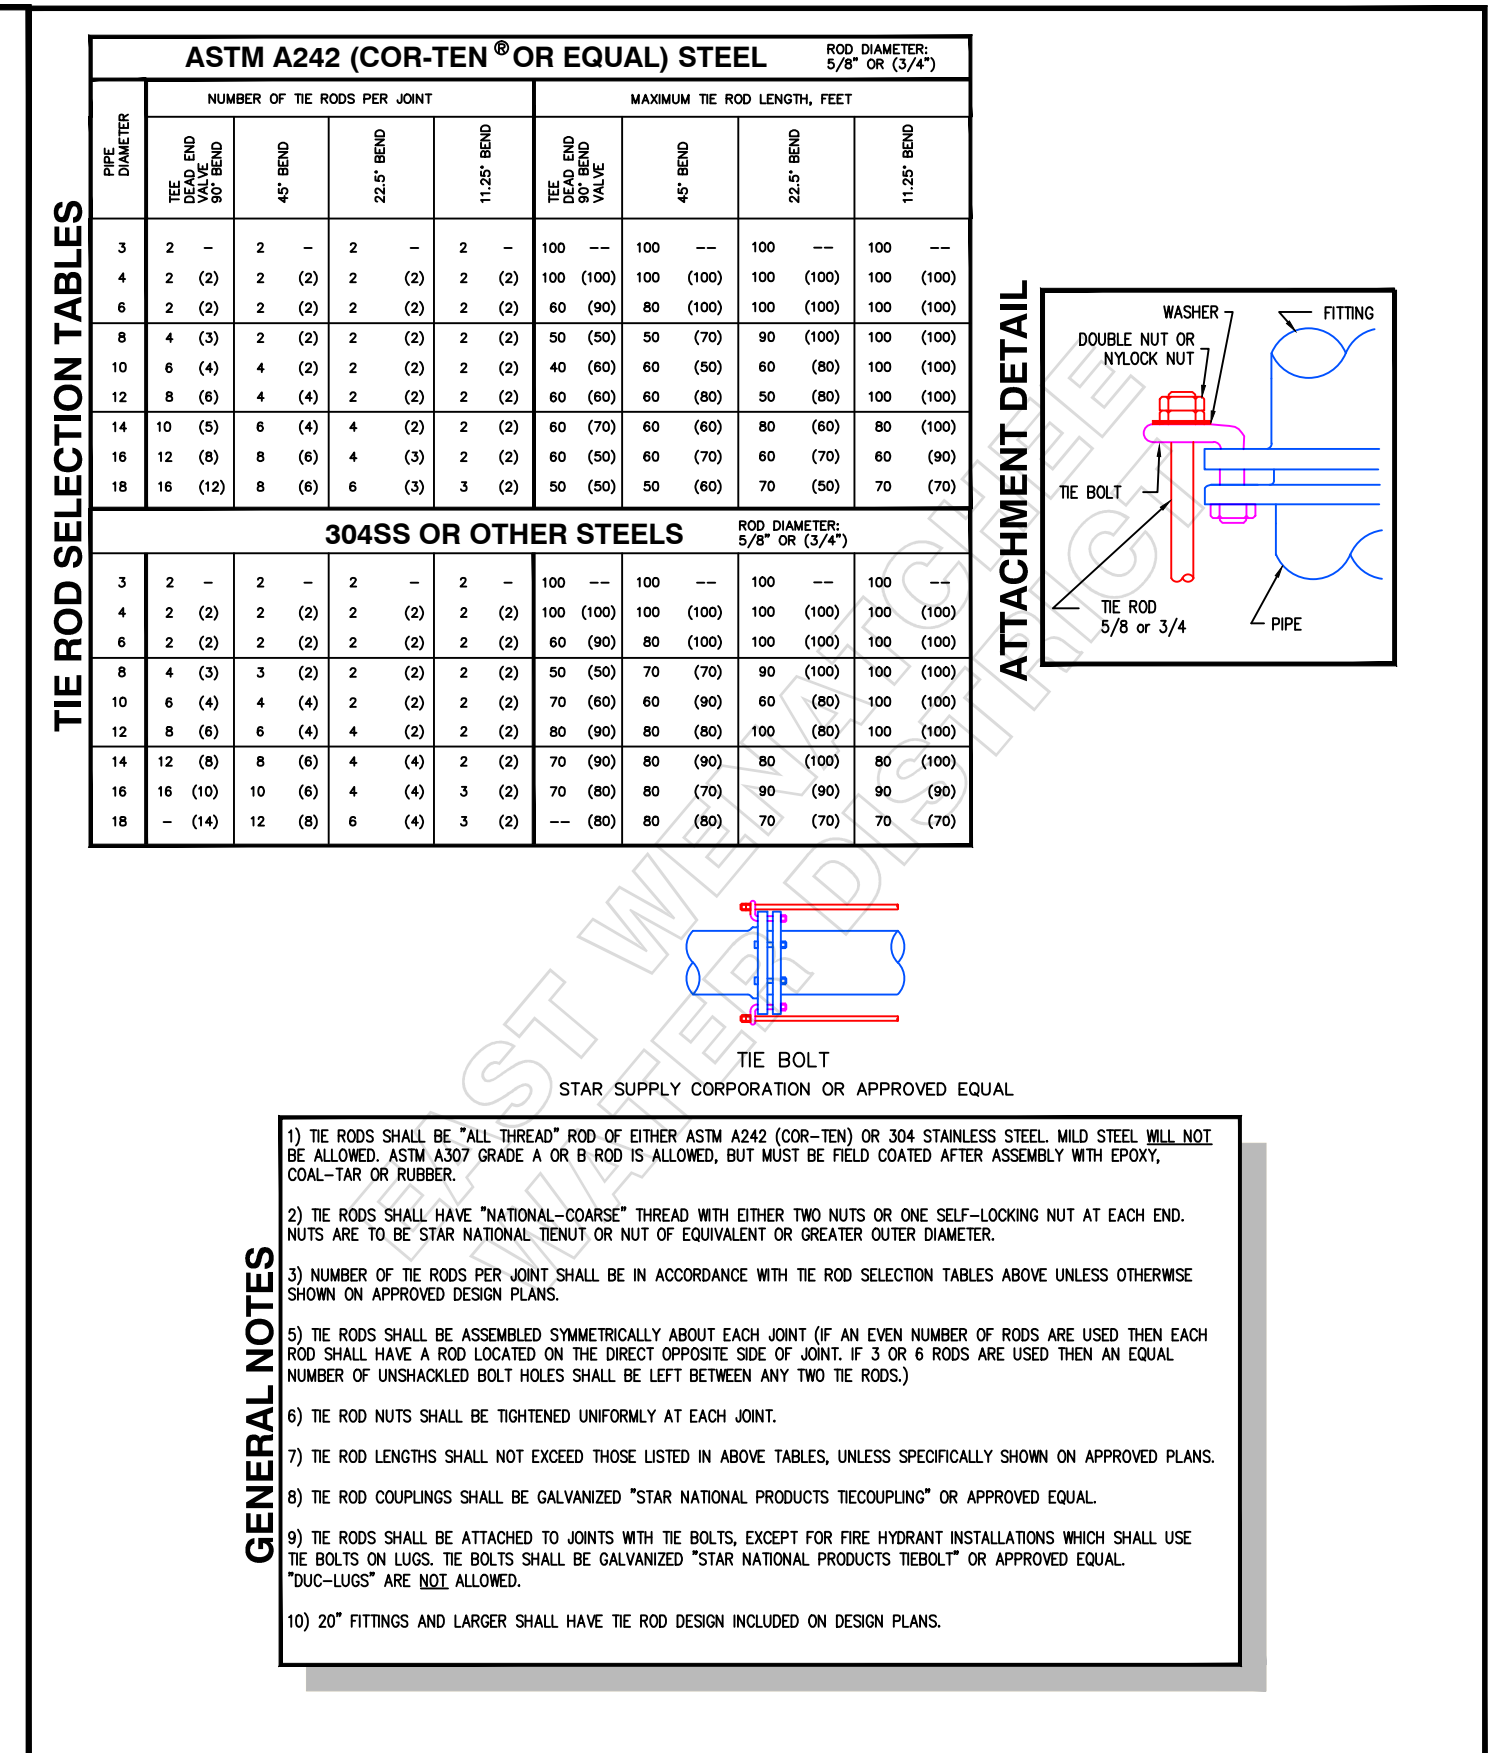

<b>East Wenatchee Water District</b>	WATER SYSTEM STANDARD DETAIL		
	<b>TIE RODS</b>		
File:EMDTW17	Revised: JAN 25, 2017	Printed: JAN 25, 2017	

